




PLAN SCALE: 3/8" = 1'-0"

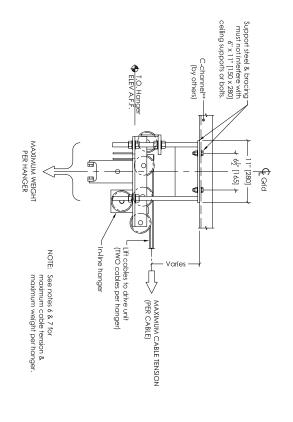

B | SECTION - LOADS @ HANGERS

DETAIL - SKYFOLD MECHANICAL

B.O. Acoustic barrier ELEV A.F.F.

THIS DRAWING IS IN INTENDED AS A GUIDE. IN ALL CASES SKYFOLD SHOP DRAWINGS SPECIFIC TO EACH PROJECT ARE REQUIRED FOR FINAL BUILD-TO DIMENSIONS.



Part of the Ralltech Architectural Group

NOTES TO G.C.

E Skyfold wall

- Give special attention to any obstructions to ceiling pockets & cables (i.e. ducts, sprinkler pipes, drain pipes, electrical conduits, etc.).
- One steel C-channel** (flanges up) to be supplied & installed by others. Alternate steel support to be approved in the control of the control

Pocket framing must not interfere with motor unit & must allow for easy access via access panels.

B.O. C-channel**
ELEV

**C-channel designation:

North & South America = C8 x 11.5 [C200 x 17] Europe = C200 x 75 Asia = C200 x 80

Support steel above the wall along its axis must be parallel to the floor within $\frac{1}{2}$! [12.7] for the entire length of the wall (this includes loaded deflection).

- Attachment details of C-channel** to structure to be designed by others & must not interfere with Skyfold hangers or motor unit or lifting cables.
- Structural steel support & bracing must not interfere with motor mounts or ceiling supports.
- Sprayed-on freproofing (mineral wool & cement) is not recommended for use on the steel support to which Skyfold is attached. An intumescent coating or firm is preferred. Local building codes must be respected. Freproofing is by others.
- Maximum cable tension: (TWO cables per hanger) Approximate weight of wall: Maximum weight per hanger: XXXX lbs. [XXXX Kg.] XXX lbs. [XXX N.]
- Specified electrical: 208 VAC, 3Ø, 60 Hz.
- THE ELECTRICAL CONTROL BOX IS TO BE MOUNTED BY THE ELECTRICAL CONTRACTOR. POWER MUST BE AVAILABLE AT TIME OF INSTALLATION.
- 24 volt key switch controls & boxes to be installed by electrical contractor as per standard light switch. Boxes to be fitted at desired key, switch location with suitable cable run back through ceiling void to control box position, including sufficient spate to allow connection. Key switches are supplied by Skyfold & are required on each side of the wall.
- Motor size: Varies project-specific.
 Full load amp: XXXX A
- Skyfold requires two 24" x 24" (610 x 610] (minimum) occess panels in acoustic ceiling difectly beside motor for installation & maintenance of system. Not required if finished ceiling is suspended ceiling files.
- Drive unit to be installed prior to construction of acoustic barrier & pocket. All pocket construction (gypsum, suspended ceiling tile, framing, etc.) is by others.
- Do not scale from this drawing. All dimensions must be verified on site.
- Dimensions in [] are in millimeters (mm) unless noted otherwise. LEGEND

CEILING SUPPORT & HANGER

CEILING ACCESS PANEL

Acoustic barrier

Adapter plate (by Skyfold)

1 HP motor maximum torque 13875 lbin [1570 Nm]

— 8<u>1</u>" [205] —

5" [128] -

C-channel** flanges up (by others)

17" [430] minimum clearance required


· 2'-6³" [780] ± -


Skyfold wall → 2⅔" [60]±

TYPICAL EVEN SKYFOLD WALL


PLAN & MECHANICAL DETAILS X @ X'-X" [XXXX] \times X'-X" [XXXX] B.O.Pocket Large capacity compact drive unit

S2020	Drawing No.	Skyfold project No.	Drawn by
			Date
	As noted	Scale	Approved by
З	1 of 2	Sheet No.	Date

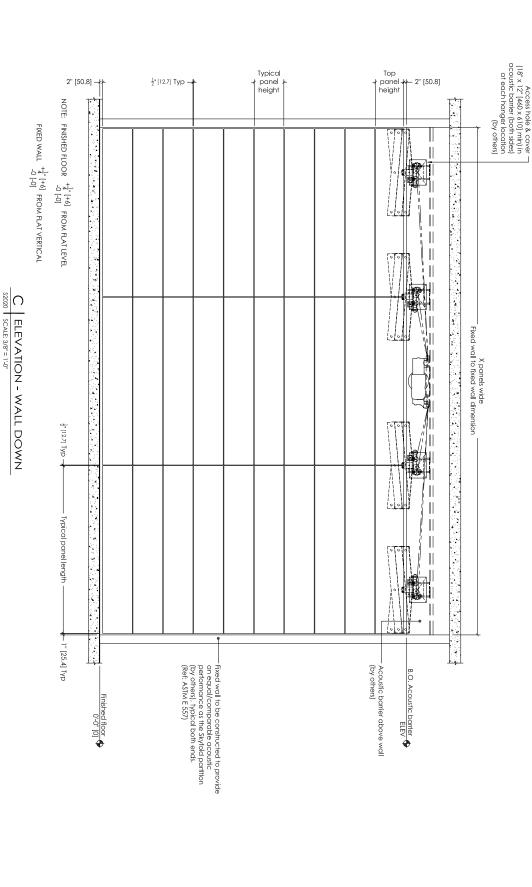

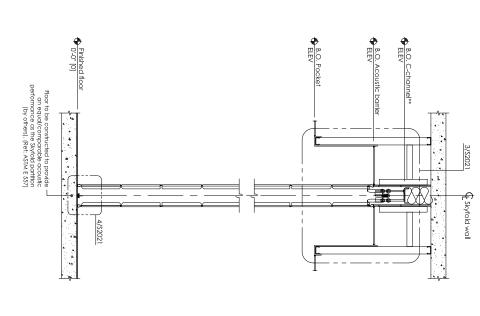

D SECTION - WALL DOWN

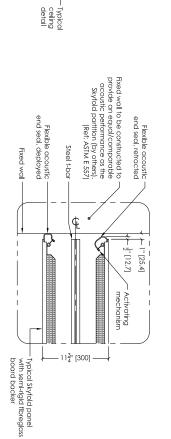

B.O. Pocket ELEV A.F.F.

3 POCKET DETAIL
szozi scale;11/2"=1-0"

Pocket width dimension

Equal

B.O. Acoustic barrier ELEV A.F.F.

"J" or "U" trim -(by others)

 Flexible acoustic ceiling seal Suspended ceiling tile only (by others)


Typical Skyfold panel


Ceiling supports to be — attached to C-channel** before construction of acoustic barrier & pocket


Lateral brace as required (by others)Stud (by others)

- 9½" [241] ---

Acoustic barrier: two layers gypsum board, both sides, with acoustic material to provide an equal/comparable acoustic performance as the Skyfold partition (by others). (Ref. ASTM E 557)







SKYFOLD®

Part of the Ralltech Architectural Group

NOTES TO G.C.

Any obstructions to ceiling pockets & cables (i.e. ducts, sprinkler pipes, drain pipes, electrical conduits, etc.),

Give special attention to:

- Tolerances of fixed walls & finished floor,
- Removable ceiling tile for top of pocket.
- Acoustic performance:

Skyfold Classic

North America: STC: 51 as per ASTM E90

Rw: 51 as per ISO 140-3, Part 3 & ISO 717-1.2

Skyfold Classic Elite

North America: STC: 57 as per ASTM E90

Rw: 56 as per ISO 140-3, Part 3 & ISO 717-1.2

North America:

Skyfold Classic NR

STC: 50 as per ASTM E90 NRC: 0.65 as per C423

Rw: 49 as per ISO 140-3, Part 3 & ISO 717-1.2 SAC: 0.65 as per ISO 354.

Skyfold requires two $2\ell^* \times 2\ell^*$ (6)0 x 610] (minimum) access panels in acoustic celling directly beside motor for installation & moniterance of system. Not required if finished celling is suspended celling tiles.

- The floor underneath the wall along its axis must be flat to within $\frac{1}{4}$ " (6) over the entire length of the wall. A peak to valley unaulation of $\pm \frac{1}{4}$ " (6) must not be closer together than 24" (610). A peak to valley unaulation of $\pm \frac{1}{8}$ " (3) must not be aloser together than 12" (305). Drive unit to be installed prior to construction of acoustic barrier & pocket. All pocket construction (gypsum, suspended ceiling tile, framing, etc.) is by others.
- Do not scale from this drawing. All dimensions must be verified on site.
- Dimensions in [] are in millimeters (mm) unless noted otherwise.

**C-channel designation:

North & South America = C8 x 11.5 [C200 x 17] Europe = C200 x 75 Asia = C200 x 80

THIS DRAWING IS IN INTENDED AS A GUIDE. IN ALL CASES SKYFOLD SHOP DRAWINGS SPECIFIC TO EACH PROJECT ARE REQUIRED FOR FINAL BUILD-TO DIMENSIONS.

X @ X'-X" [XXXX] x X'-X" [XXXX] B.O. Pocket Large capacity compact drive unit

TYPICAL EVEN SKYFOLD WALL

PANEL & POCKET DETAILS

rawn by Date Approved by	srchifect Contractor
Date	

Approved by	POIN
	Orto

S2021