## **ESKYFOLD**®

NOTES TO G.C.

ELECTRICAL CONTRACTOR.

1. Specified electrical: 208 VAC, 3Ø, 60 Hz.

\* POWER MUST BE AVAILABLE AT TIME OF INSTALLATION.

2. 24 volt key switch controls & boxes to be installed by

See PLAN/SXXXX for key switch positions.

4. Do not scale from this drawing. All dimensions must be

5. Dimensions in [] are in millimeters (mm) unless noted

3. Motor size: Varies - project-specific

Full load amp: XXXX A

verified on site.

otherwise.

THE ELECTRICAL CONTROL BOX IS TO BE MOUNTED BY THE


electrical contractor as per standard light switch. Boxes to

be fitted at desired key switch location with suitable cable


including sufficient spare to allow connection. Key switches are supplied by Skyfold & are required on each side of the

run back through ceiling void to control box position,


## AC POWER INPUT: 208 - 240 VAC FOR 1 HP & LESS (5 AMPS FUSED ISOLATOR)

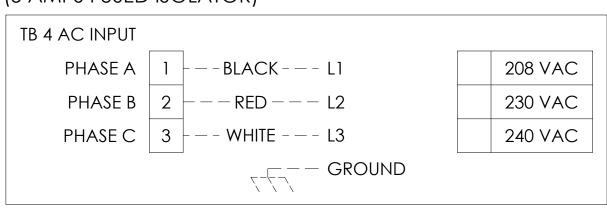


AC POWER INPUT: 208 - 240 VAC FOR 1.5 HP & GREATER AND 380 VAC & GREATER FOR ALL HP (15 AMPS FUSED ISOLATOR)

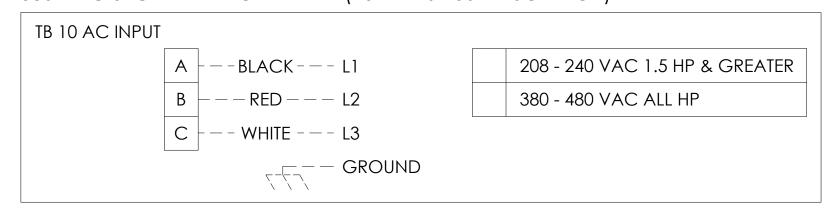


## WIRING DIAGRAM FOR ILLUMINATED PUSH BUTTON & KEY SWITCHES IN SERIES (SKYFOLD SWITCHES ONLY)

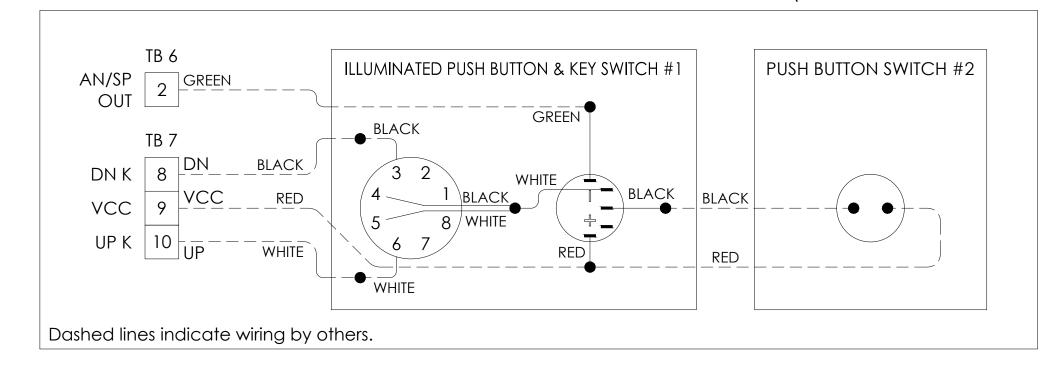

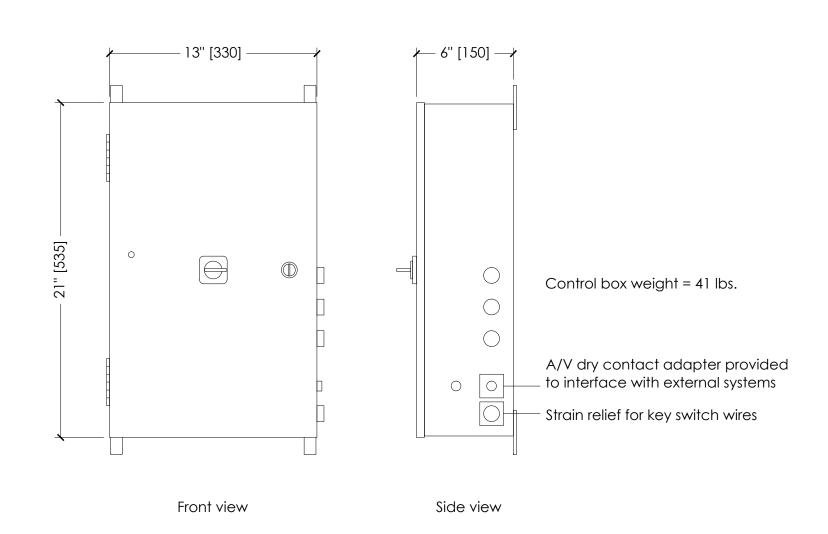


CONTROL BOX

SCALE: NONE

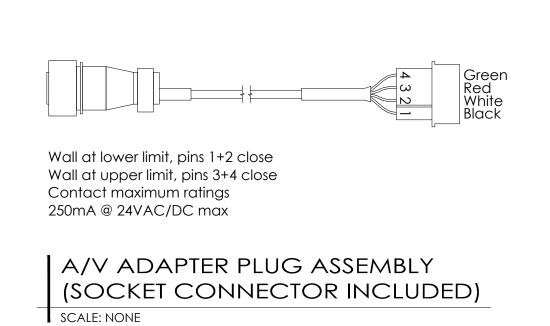

ELEVATION SHOWING KEY SWITCHES


SCALE: 1/2" = 1'-0"

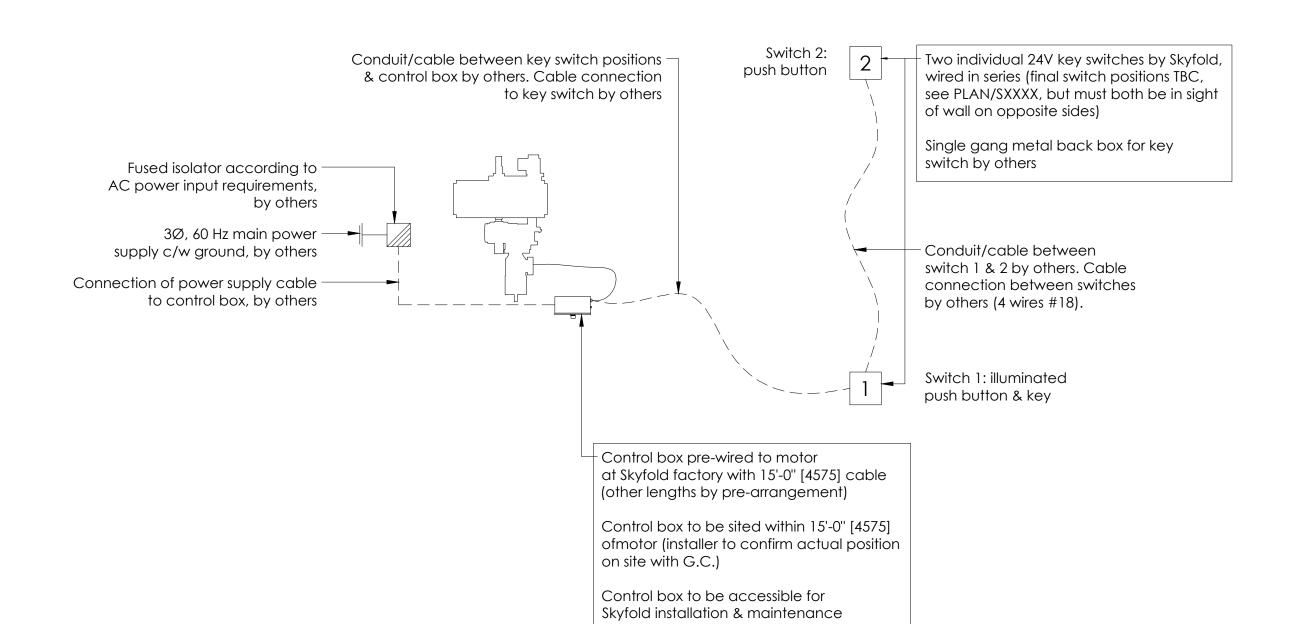

SCALE: NONE

by others

Key switch connection to control box

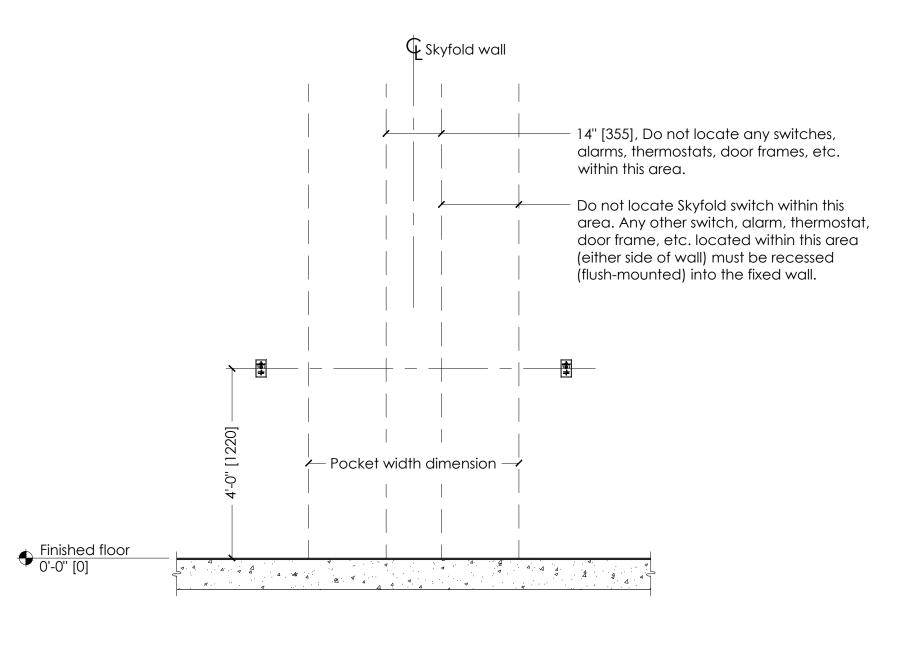

THIS DRAWING IS INTENDED AS A GUIDE. IN ALL CASES

ARE REQUIRED FOR FINAL BUILD-TO DIMENSIONS.

SKYFOLD SHOP DRAWINGS SPECIFIC TO EACH PROJECT

Authorized Skyfold distributor

TYPICAL SKYFOLD WALL

Drawing title

X @ X'-X" [XXXX] x X'-X" [XXXX] B.O. Pocket Standard drive unit

ELECTRICAL DETAILS

Skyfold project No.  Scale  As noted  Drawing No.	
As noted  Drawing No.	Date
Drawing No.	Sheet No.
-	3 of 3
SXXXZ	Revision
JAAAL	5